

Rokeby Generating Station Saves 50% in Capital Expense by Using Liqui-Cel® 14x28 Membrane Contactors to Remove CO₂ to Extend Mixed Bed Resin Life

Lincoln Electric Systems (LES) recently commissioned a membrane decarbonation system using Liqui-Cel® 14x28 Membrane Contactors to remove CO₂ prior to their mixed bed deionizers. The system was installed at the Rokeby Generating Station (RGS) in Lincoln, Nebraska.

Background

The Rokeby Generating Station is LES' primary peaking power station, totaling 255 MW and consisting of 3 dual fuel combustion turbines. The existing DI water system consisted of two single-pass, two-stage RO skids followed by a 31 ft³ (0.87 m³) mixed bed deionizer and two 250,000-gallon (943 m³) storage tanks.

LES determined that the mixed bed unit was producing only 30% of its expected capacity (90,000 gallons actual vs. 300,000 gallons expected or 341 m³ actual vs. 1136 m³ expected). It was determined that the cause of the decreased capacity was due to dissolved CO₂ in the water, which was overloading the anion resin. As the power capacity demand increased, LES had to act quickly to update their winter contingency plans.

Treatment Options


Multiple treatment options including chemical treatment and the installation of a forced draft degasifier were considered. Ultimately, chemical treatment was considered too risky because of its negative impact on increasing scale on the RO membranes. A forced draft deaerator was also considered impractical due to the large capital expense and size constraints at LES.



System Design

In 2005, LES began engineering a membrane decarbonation system using Liqui-Cel 14x28 Membrane Degasifiers. The system was designed to treat the combined water flow from both RO skids, approximately 150 GPM (0.6 m³). The goal was to achieve approximately 90% reduction of dissolved CO₂. Additionally, the system was designed to operate with vacuum assisted air sweep, using a liquid ring vacuum pump to draw atmospheric air through the Liqui-Cel Membrane Contactors.

Figure 1

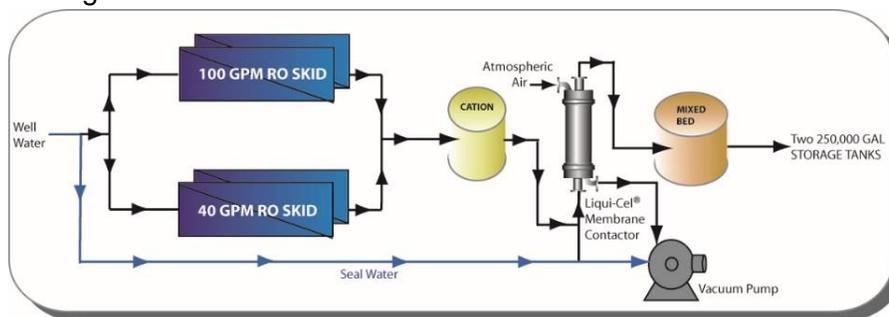

Since the LES staff was able to design, fabricate, and install the Liqui-Cel® degassing system, the total capital cost was approximately 50% less than the cost of a forced draft degasifier. The compact design also allowed LES to build the system inside of an existing building with minimal modification. The low system pressure drop through a Liqui-Cel Membrane Contactor system also eliminated the need for a re-pressurization pump further lowering operating costs for LES.

The degas skid was installed downstream of the RO skids and before the mixed bed. In order to maximize efficiency, a cation bottle was installed between the RO skids and the degas skid to reduce the pH and convert the HCO₃ to free CO₂ gas. (See Fig. 1)

Test Set Up

LES temporarily installed three 3.3 ft³ (0.09 m³) mixed bed bottles downstream of the degas skid. The bottles were installed in parallel for a total capacity of 9.9 ft³ (0.28 m³). During the test, only one of the RO units was operated, resulting in water flow of 40 GPM.

LES expected to achieve 138,000 to 168,000 gallons (522 m³ – 636 m³) throughput with this design. They actually achieved 191,000 gallons (725 m³). Specific conductivity was 0.5 μS/cm and silica was 7.5 ppb. LES estimates the full-scale capacity will be approximately 617,000 gallons [(32 ft³ / 9.9 ft³)*191,000 = 617,374 gallons (2337 m³)]. This represents an increase in the total capacity of the system by a factor of 5.9.

Summary

Liqui-Cel Membrane Contactors offer a cost-effective, efficient option for removal of carbon dioxide from process water. Removal of carbon dioxide prior to the mixed bed resins *significantly* improves regeneration times, thereby reducing operating costs and improving overall efficiency by minimizing downtime.

If you would like a Membrana representative to size a Liqui-Cel Membrane Contactor system for your application, please visit www.liquicel.com and click “contact us”, or call us at the numbers listed below.

Technical Information: The technical information, recommendations and other statements contained in this document are based upon tests or experience that 3M believes are reliable, but the accuracy or completeness of such information is not guaranteed.

Product Use: Many factors beyond 3M's control and uniquely within user's knowledge and control can affect the use and performance of a 3M product in a particular application. Given the variety of factors that can affect the use and performance of a 3M product, user is solely responsible for evaluating the 3M product and determining whether it is fit for a particular purpose and suitable for user's method of application.

Warranty, Limited Remedy, and Disclaimer: Unless an additional warranty is specifically stated on the applicable 3M product packaging or product literature, 3M warrants that each 3M product meets the applicable 3M product specification at the time 3M ships the product. 3M MAKES NO OTHER WARRANTIES OR CONDITIONS, EXPRESS OR IMPLIED, INCLUDING, BUT NOT LIMITED TO, ANY IMPLIED WARRANTY OR CONDITION OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE OR ANY IMPLIED WARRANTY OR CONDITION ARISING OUT OF A COURSE OF DEALING, CUSTOM OR USAGE OF TRADE. If the 3M product does not conform to this warranty, then the sole and exclusive remedy is, at 3M's option, replacement of the 3M product or refund of the purchase price.

Limitation of Liability: Except where prohibited by law, 3M will not be liable for any loss or damage arising from the 3M product, whether direct, indirect, special, incidental or consequential, regardless of the legal theory asserted, including warranty, contract, negligence or strict liability.

3M, Membrana and Liqui-Cel are trademarks of 3M Company. © 2015 3M Company. All rights reserved. (TB57)



**Industrial Business Group
Membranes Business Unit**
13840 South Lakes Drive
Charlotte, North Carolina 28273
USA

Phone: +1 704 587 8888
Fax: +1 704 587 8610

**3M Deutschland GmbH
Membranes Business Unit**
Öhder Straße 28
42289 Wuppertal
Germany

Phone: +49 202 6099 - 658
Fax: +49 202 6099 - 750

**3M Japan Ltd.
Membranes Business Unit**
6-7-29, Kita-Shinagawa,
Shinagawa-ku, Tokyo | 141-8684
Japan

Phone: +81 3 6409 5732
Fax: +81 3 6409 5827

MEMBRANA
Now proudly part of 3M

www.liqui-cel.com